


Operation-tested HMIs (Gateway Mode)

- HMI: OMRON Corporation NS12-TS01-V1
- Driver: Mitsubishi A Series Computer Link

Cable Diagram : O-2

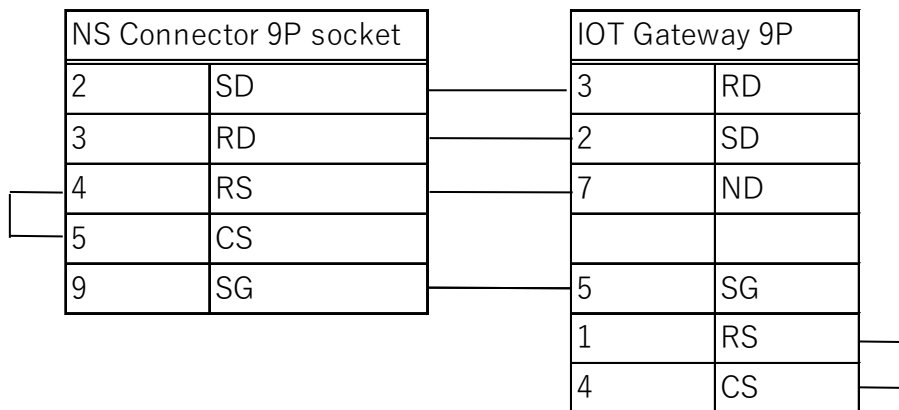

Able to connect by using the communication driver of GP-Pro EX Ver. 4.08.000. Unable to connect when GP-Pro EX with an earlier version than ver. 4.08.000 is used.



SCIGATE AUTOMATION (S) PTE LTD


No 1 Bukit Batok Street 22 #01-01 Singapore 659592
Tel: (65) 6561 0488 Fax: (65) 6561 0588
Email: sales@scigate.com.sg Web: <https://scigate.com.sg/>

Business Hours: Monday - Friday 8:30AM - 6:15PM

Operation-tested HMIs (Gateway Mode)

- HMI: OMRON Corporation NS12-TS01-V1
- Driver: Mitsubishi Q/QnA Serial Communication


Cable Diagram : O-1

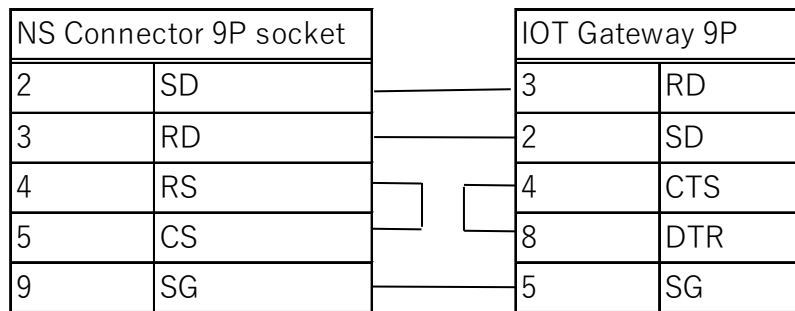

Operation-tested HMIs (Gateway Mode)

- HMI: OMRON Corporation NS12-TS01-V1
- Driver: Mitsubishi FX Series Computer Link

Cable Diagram : O-1

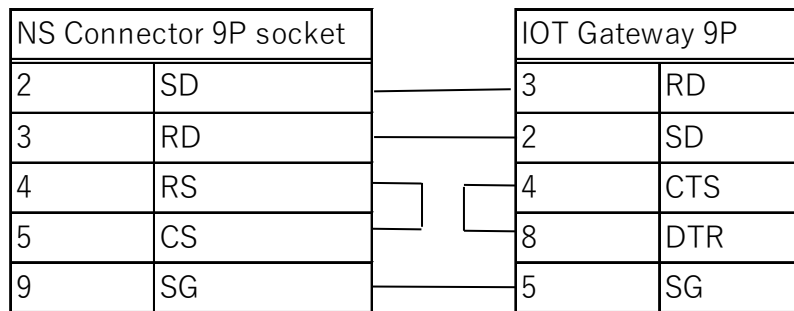


Able to connect by using the communication driver of GP-Pro EX Ver. 4.08.000. Unable to connect when GP-Pro EX with an earlier version than ver. 4.08.000 is used.

Operation-tested HMIs (Gateway Mode)

- HMI: OMRON Corporation NS12-TS01-V1
- Driver: OMRON C/CV Series HOST Link


Cable Diagram : O-1

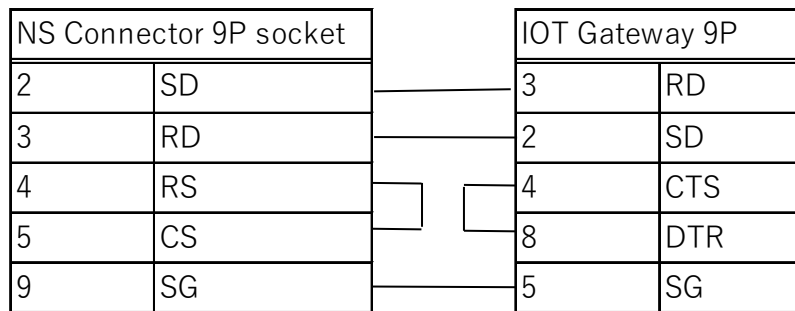

Operation-tested HMIs (Gateway Mode)

- HMI: OMRON Corporation NS12-TS01-V1
- Driver: OMRON CS/CJ Series HOST Link

Cable Diagram : O-1

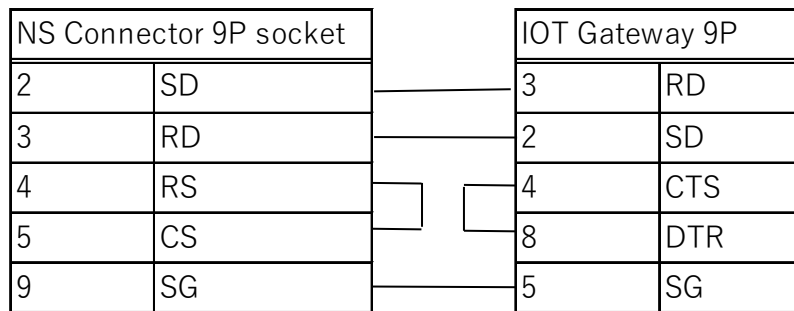

When the target PLC is CS/CJ series, you need to select [OMRON C/CV series HOST Link] for the communication protocol of GP-4G01.